

INSTALLATION INSTRUCTION

INSTALLATION INSTRUCTIONS FOR 560200 RETURN AIR GRILLE USED WITH B5SM-090/120 SERIES AIR HANDLER

FORM# 570D-0110

I - SHIPPING AND PACKING LIST

Package 1 of 1 contains:

- 1 ea. - Return Air Grille Assembly
- 12 ea. - Screws

Check contents for shipping damage. Contact the last carrier immediately if any shipping damage is found.

II - APPLICATION

The return air grille assembly is constructed of sturdy 20 Ga. painted galvanized steel with an aluminum grille. It is designed for application on NORDYNE B5SM Series - 7.5 and 10 Ton Light Commercial Air Handlers.

Read these instructions in their entirety before proceeding with the installation of the this accessory kit.




Warning:


This kit is to be installed by a qualified service technician in accordance with these instructions and all codes having jurisdiction. Failure to follow these instructions could result in serious injury, property damage, or death. These instructions are primarily intended to assist qualified individuals experienced in the proper installation of this appliance. Some local codes require licensed installation/service personnel for this type of equipment.

III - INSTALLATION

1. **DISCONNECT ALL POWER TO UNIT.**
2. Align the return air grille assembly over the 1" duct flanges of the air handler filter rack assembly.
3. Secure return air grille assembly to the unit using screws provided with this kit.
4. **Reconnect power back to the unit.**

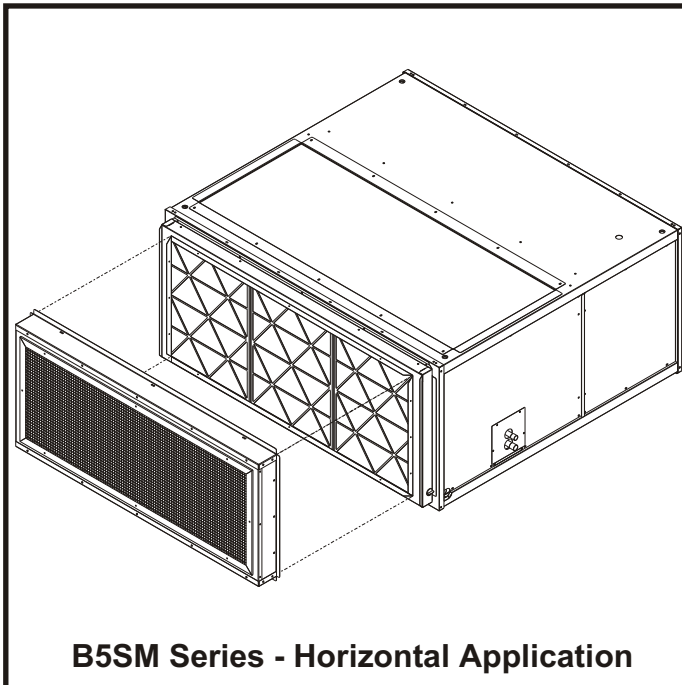

B5SM Series - Horizontal Application

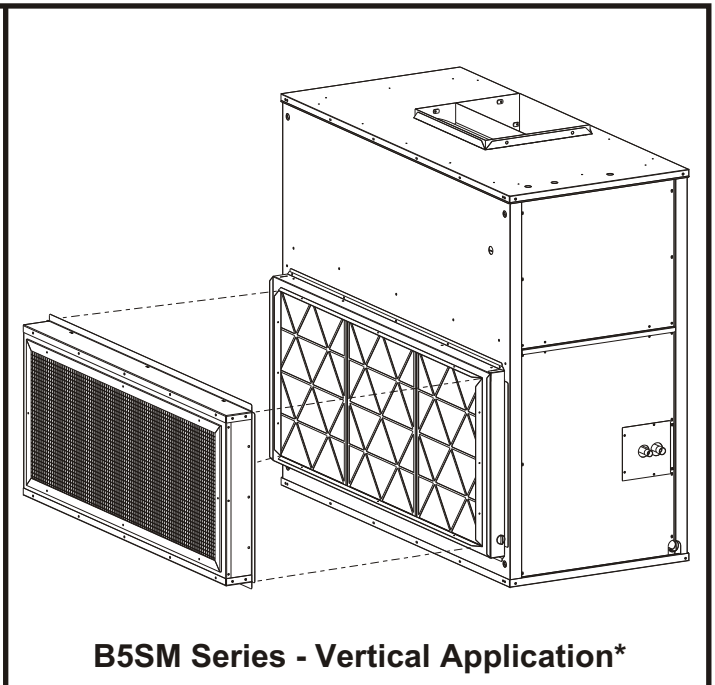

B5SM Series - Vertical Application*

*Air handler shipped from factory for horizontal application. See air handler installation instructions for conversion from horizontal to vertical application.